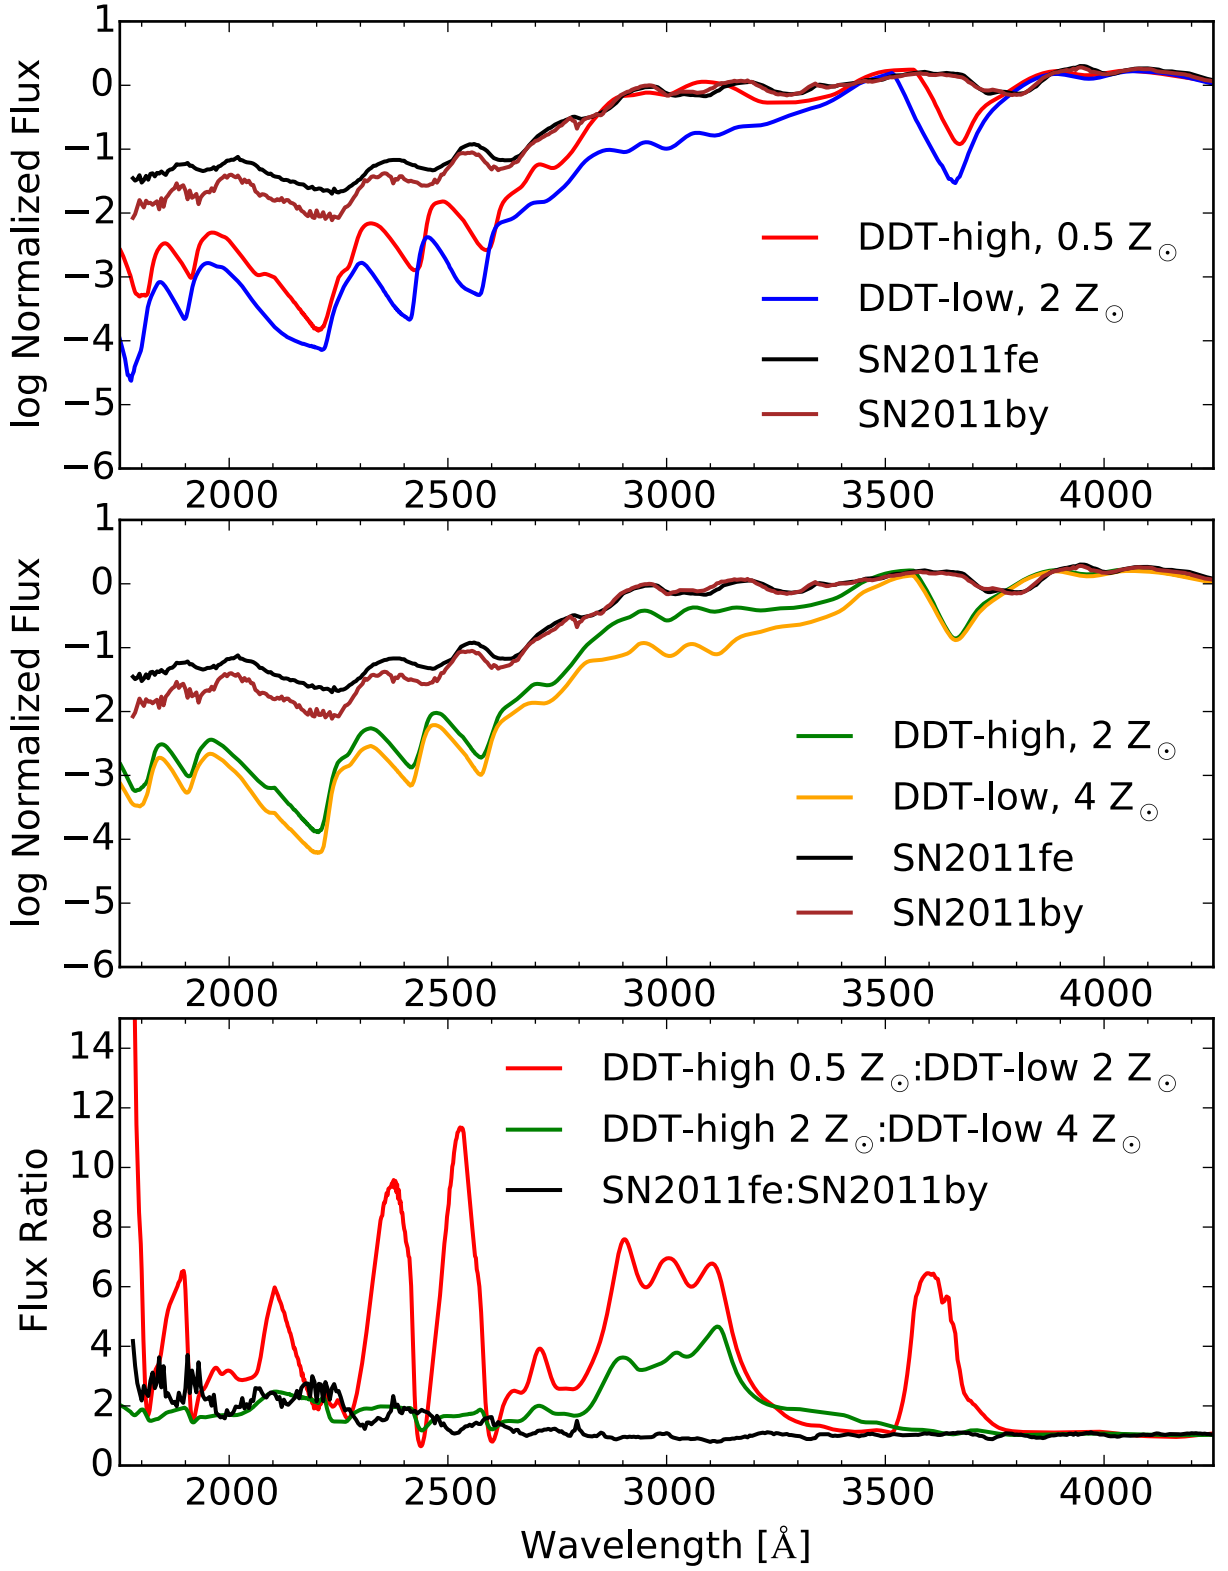
log Normalized Flux
DDT-high, 0.5 Z⊙
DDT-low, 2 Z⊙
SN2011fe
SN2011by
log Normalized Flux
DDT-high, 2 Z⊙
DDT-low, 4 Z⊙
SN2011fe
SN2011by
Flux Ratio
DDT-high 0.5 Z⊙:DDT-low 2 Z⊙
DDT-high 2 Z⊙:DDT-low 4 Z⊙
SN2011fe:SN2011by
Wavelength [Å]